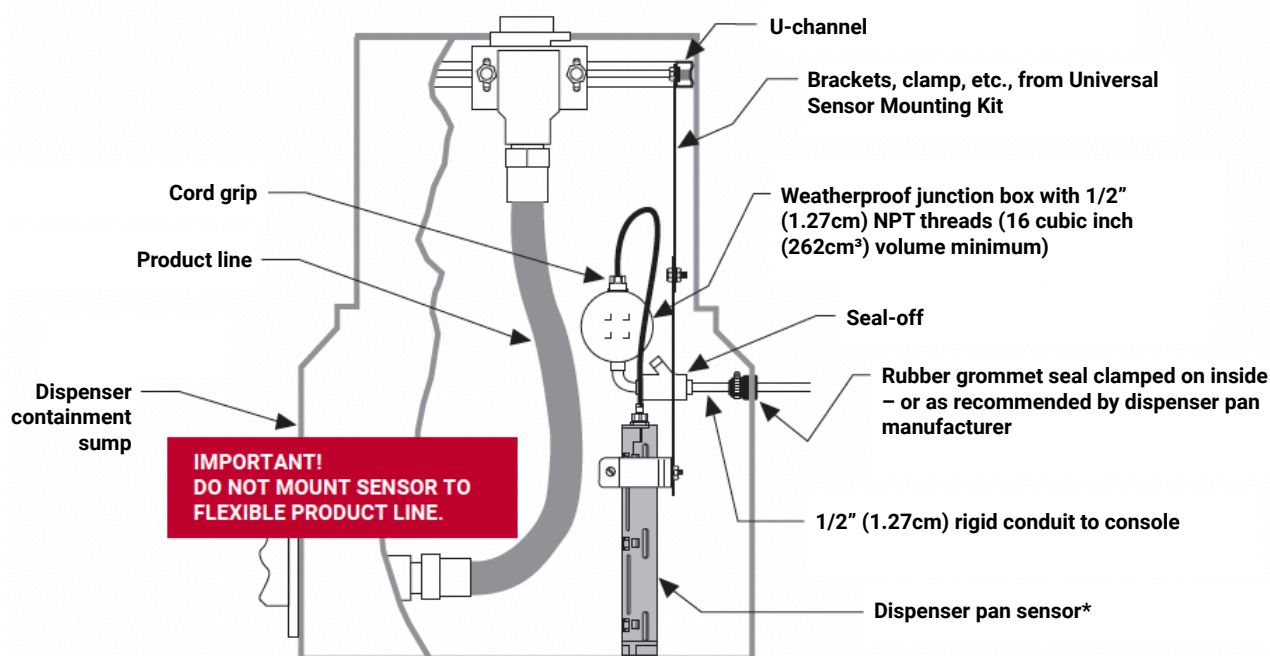


Sensor Description	Discriminating Dispenser Pan Sensor	This type of discriminating sensor is installed in a dispenser pan and will detect the presence of, and differentiate between, hydrocarbons and other liquids.				
Part Number	0794380-322					
Category	<input checked="" type="checkbox"/> Discriminating <input type="checkbox"/> Non-Discriminating <input type="checkbox"/> Position Sensitive			<input type="checkbox"/> Level Sensing <input type="checkbox"/> Static Testing <input type="checkbox"/> Hydrostatic		
Fuel Compatibility	<input checked="" type="checkbox"/> Gas <input checked="" type="checkbox"/> Diesel <input checked="" type="checkbox"/> Kerosene <input checked="" type="checkbox"/> Jet Fuel <input checked="" type="checkbox"/> Aviation Gas			<input checked="" type="checkbox"/> E-15 <input checked="" type="checkbox"/> E-85 ¹ <input type="checkbox"/> E-100 <input checked="" type="checkbox"/> Bio-Diesel 20 <input type="checkbox"/> Bio-Diesel 100		
				<input checked="" type="checkbox"/> Green Diesel <input type="checkbox"/> DEF <input checked="" type="checkbox"/> Waste Oil <input checked="" type="checkbox"/> Motor Oil		
¹ Single use only (Test per Sensor Operability Guide in E-10 or less)						
Console Compatibility	Recommended Min. Console Software	Sensor Interface Modules				
		Module Part #	Module Description	# of Modules per Console	# of Sensor Inputs per Module	Availability
TLS-450PLUS (8600 Series)	6.A or Higher	0332812-001	Universal Sensor Module (USM)	Up to 4 – TLS-4xx Up to 8 – TLS-4xx w/ opt. TLS-XB	16	Sold Separately
TLS-450	4.A or Higher					
TLS4 (8601 Series)	6.A or Higher	0330020-750	Universal Sensor Input/Output Module (USIOM-AC)	1	12	Included
TLS4i (8601 Series)						
TLS4B (8601 Series)						
TLS4c (8601 Series)						
TLS-350/R/PLUS	124/324 or Higher	0329358-001	Interstitial Sensor Interface Module	Up to 8	8	Sold Separately
TLS-350J		0329356-003	4 Probe / 4 Sensor Interface Module	1	4	Sold Separately
TLS-300i		0330230-001	4 Probe / 8 Sensor Interface Module		8	Included
Alarm Notification	Normal	Sensor in Normal State – No liquid detected				
	Low Liquid	Liquid detected at a minimum of 1.37" (3.48cm)				
	High Liquid	Liquid detected at a minimum of 7.66" (19.45cm)				
	Fuel Alarm	Permeable material saturated with fuel				
	Sensor Out	Sensor not communicating to ATG/Console				
Installation Kit	0330020-012	Universal Sensor Mounting Kit (Sold Separately)				
Specifications						
Operating Principle	Product Permeable, Reed Switch / Float					
Product Activation Height	Gas – 0.125" (3.175mm) Water – Low: 1.37" (3.48cm), High: 7.66" (19.45cm)					
Operating Temperature	+32°F to +140°F (0°C to +60°C)					
Dimensions	11.6" (29.4cm) high, 2.2" (5.6cm) diameter					
Miscellaneous/Notes	Standard Cable Length: 12' (3.66m)					
Third Party Evaluation Links	TLS-3XX/TLS-450 Series Consoles TLS4 (8601 Series) Consoles					
Product Link	Discriminating Dispenser Pan Sensor					
Warranty with System	1 Year Parts & Labor					
Warranty (When purchased separately)	1 Year Parts Only					

Where Used (Typical)

- | | |
|---|---|
| <input checked="" type="checkbox"/> Dispenser Pan | <input type="checkbox"/> Annular Space |
| <input checked="" type="checkbox"/> Spill Containment | <input type="checkbox"/> Monitoring Well |
| <input type="checkbox"/> STP Sump | <input type="checkbox"/> Oil/Water Separator Tank |
| <input type="checkbox"/> Convault Tank | |

Example Installation


* Dispenser pan sensor should:

1. Rest in the cup or the lowest point of the dispenser containment sump.
2. Be positioned so as to be removable by pulling the sensor straight up out of the pan.
3. Be mounted in a true vertical position.